



1. SYMBOL DENOTES CABLE TRAY/CONDUIT SUPPORT FROM WALL/CEILING, REFER TO DWG EB.10.01 FOR TYPICAL DETAILS.
2. FOR WALL AND FLOOR PENETRATIONS REFER TO CORRESPONDING FLOOR & SECTION POWER PLANS (E4 SERIES) UON.
3. SEE POWER PLANS (E4 SERIES) FOR COMPOSITE OF TRAYS FOR ALL SERVICES.
4. ALL TRAYS SHALL BE LADDER TYPE FOR VERTICAL TRAY RISERS VENTILATED COVERS SHALL BE PROVIDED.

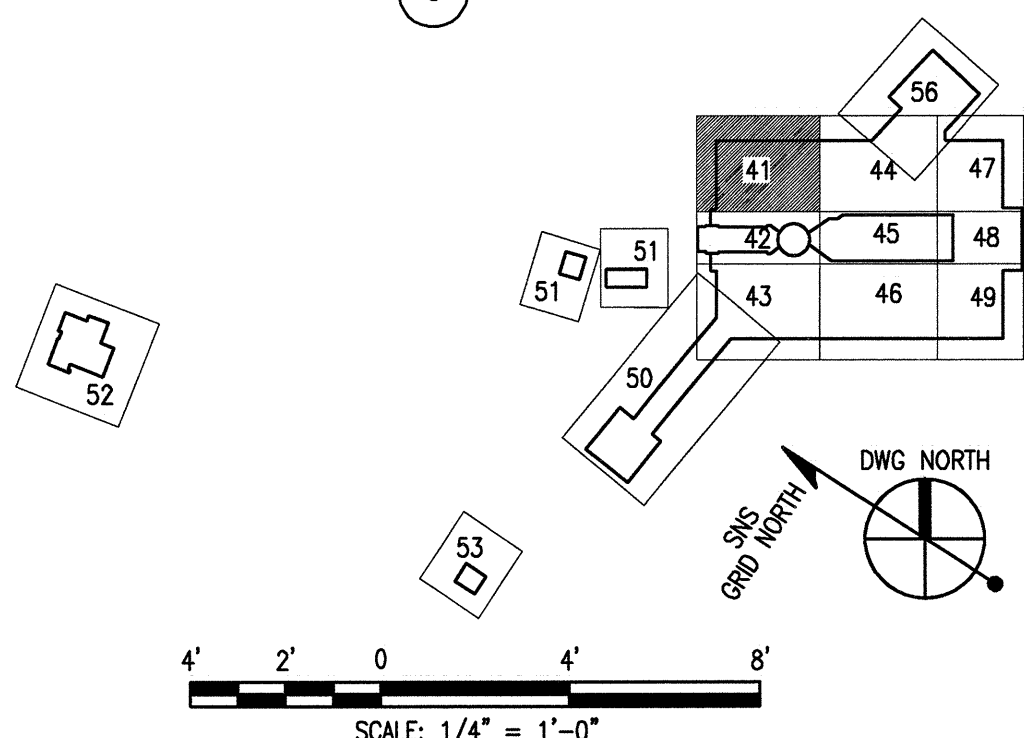

108030700-E8E-8700-A088

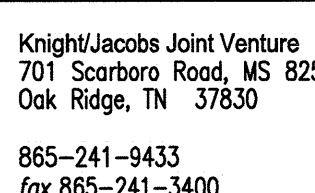

KNIGHT
Knight Advanced Technology



Oak Ridge National Laboratory
managed for the DEPARTMENT OF ENERGY under
U.S. GOVERNMENT contract DE-AC05-00OR22725

PROJECT NAME:

SPALLATION NEUTRON SOURCE
TARGET BUILDING
ELECTRICAL AUXILIARY PLAN
LEVEL 2, SECTOR 41

1 3	48 E	49 X	50 X	PLANT 8	BLDG 8700	FL	SH. 1	OF 1	TYPE P	CLAS U
51 NC		52 NA		53 WBS 1837	E5.02.41					RE 0


--	--

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS MAY NOT INFRINGE PRIVATE RIGHTS OF OTHERS. NO LIABILITY IS ASSUMED WITH RESPECT TO THE USE, OR FOR DAMAGES RESULTING FROM THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO BIDDERS ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST OF THE FORWARDING CONTRACTOR.

NUMBER OF SECTION OR DETAIL

DRAWING ON WHICH SECTION OR DETAIL IS

THIS DOCUMENT
CONTROLLED BY

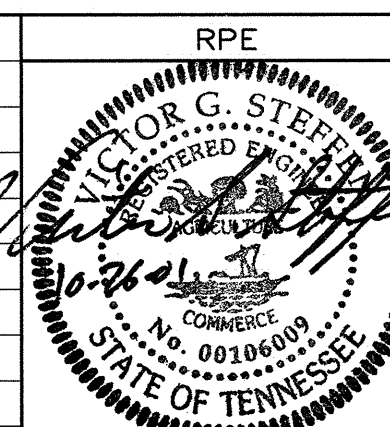CHANGE CONTROL
SYSTEM 3ENGINEERING
PROCEDURE SNS-ENG-G001[illegible]

DSN	H GROVER	10/26/0
DRW	L MAKOVSKY	10/26/0
CHK	V STEFFEN	10/26/0

DEPT		
PE	<i>1/1/19</i>	<i>11/1/19</i>

PJ	R 9 Dean	11/13/01
----	----------	----------

REQ	

11	0	1

UTB	<i>[Signature]</i>	11/13/0
-----	--------------------	---------

IG APPROVALS